Estimate for the work of providing, laying 100mm dia DI water pipeline in place of 75mm dia CI water pipelines and improve water facilities and to avoid Frequent contamination Complaint in 5th cross and 4th cross in Chamarajapet ward 140 coming under Chamarajapet Service station of AEE SW2 Sub-Division.

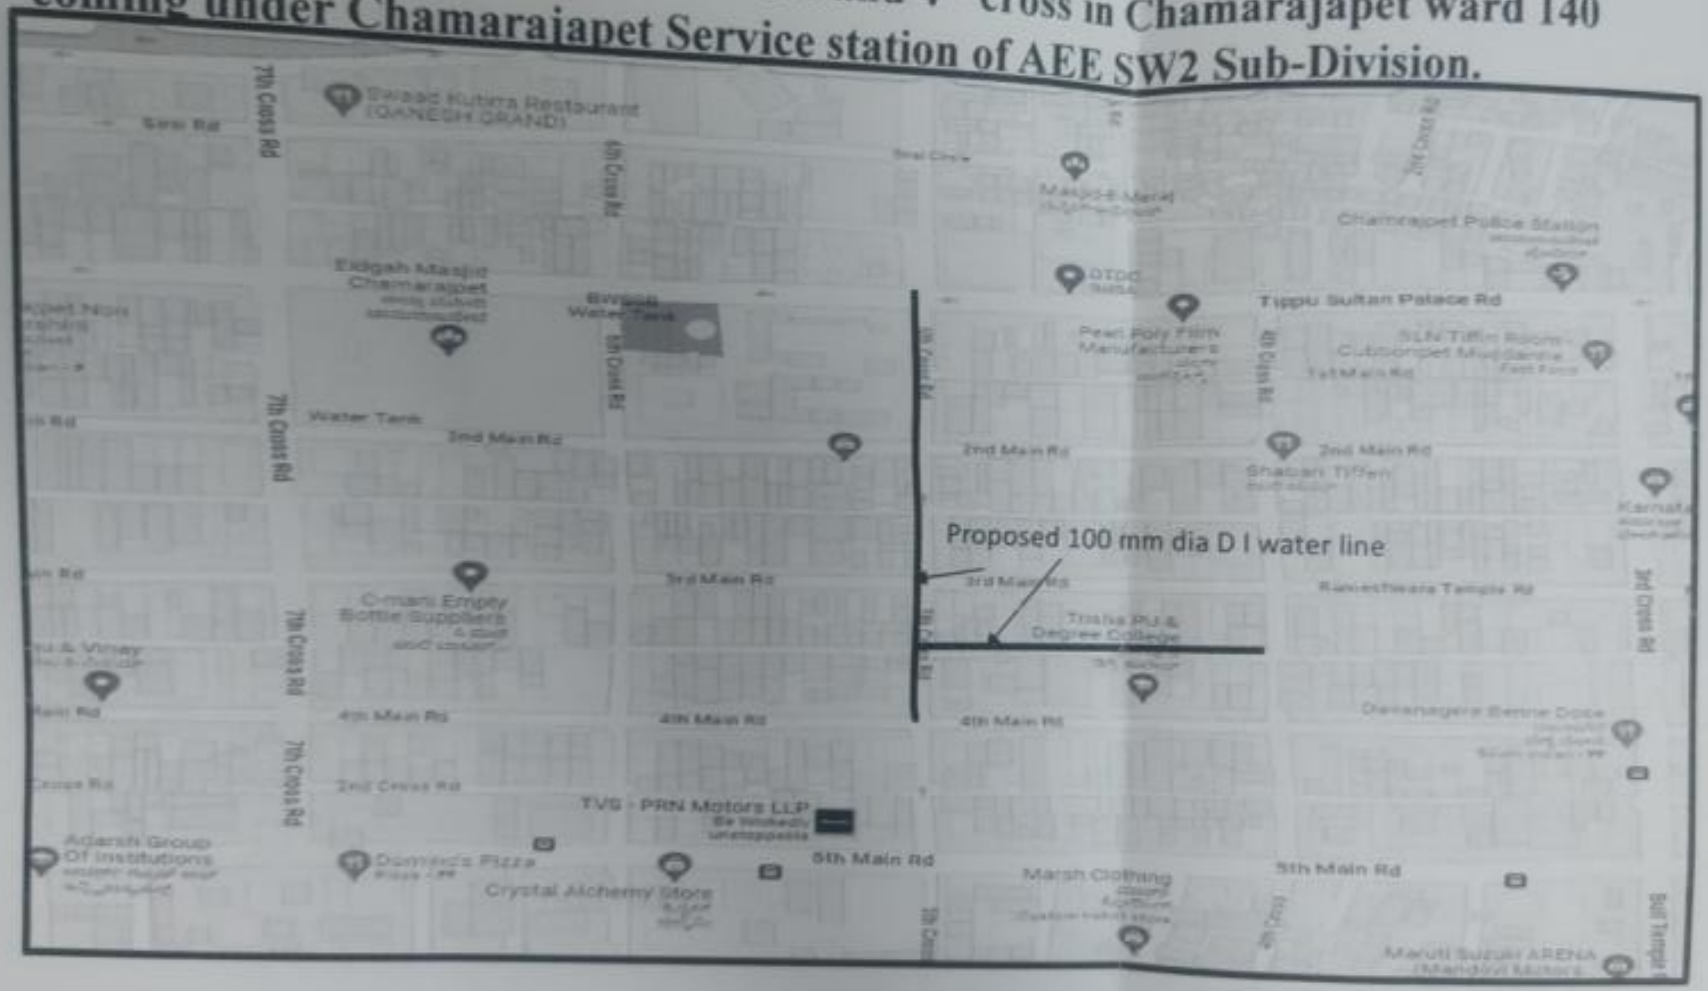

E.E.(SW)-1

GIS for the work of Providing and laying 100mmdia water pipe line in place of 75 mm dia CI water pipeline and improve water facilities and to aviod frequent Contamination Complaint in 5th cross and 4th cross in Chamarajapet ward 140 coming under Chamarajapet service station of AEESW-2 Sub Division

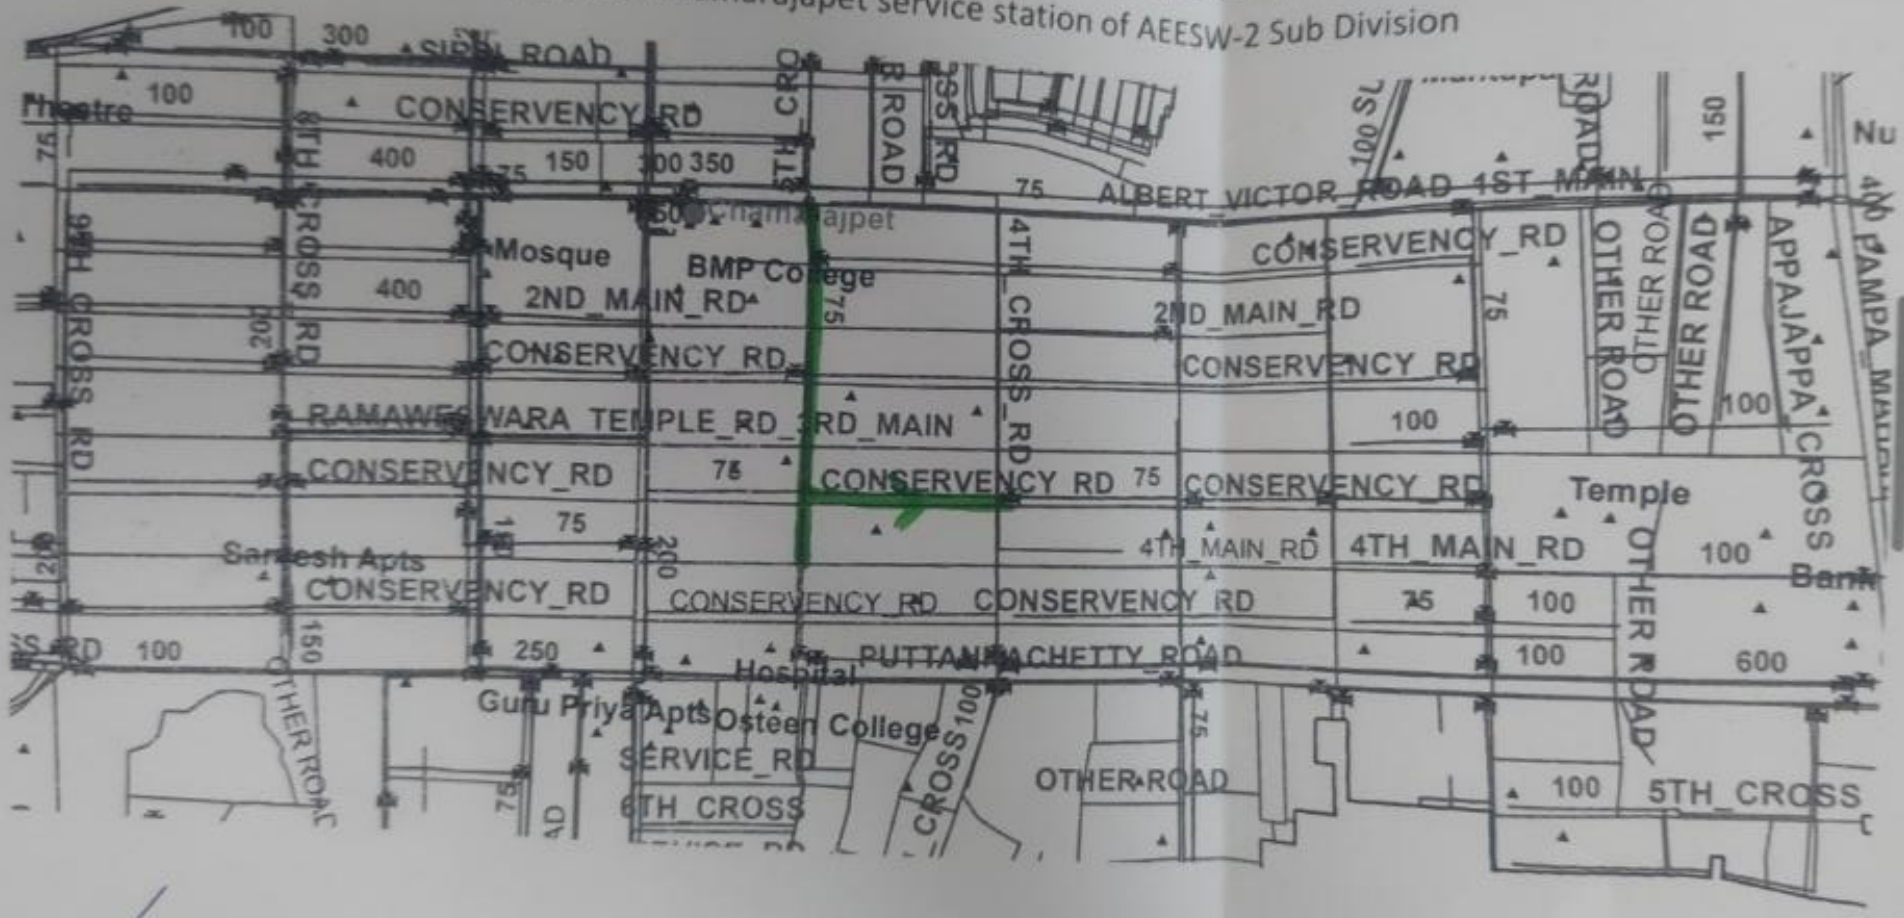

AE(Cpet)

AEESW-2
ಸಹಾಯಕ ಕಾರ್ಯ ನಿರ್ವಾಹಕ ಅಭಿಯಂತರರು
ಸಂ.2 (ದಕ್ಷಿಣ-ಪಶ್ಚಿಮ) ಉಪವಿಭಾಗ, ಬೆಂ.ಜ.ಮಂ
ವಿ.ವಿ.ಪುರಂ, ಬೆಂಗಳೂರು-560004.

EE(SW)-1

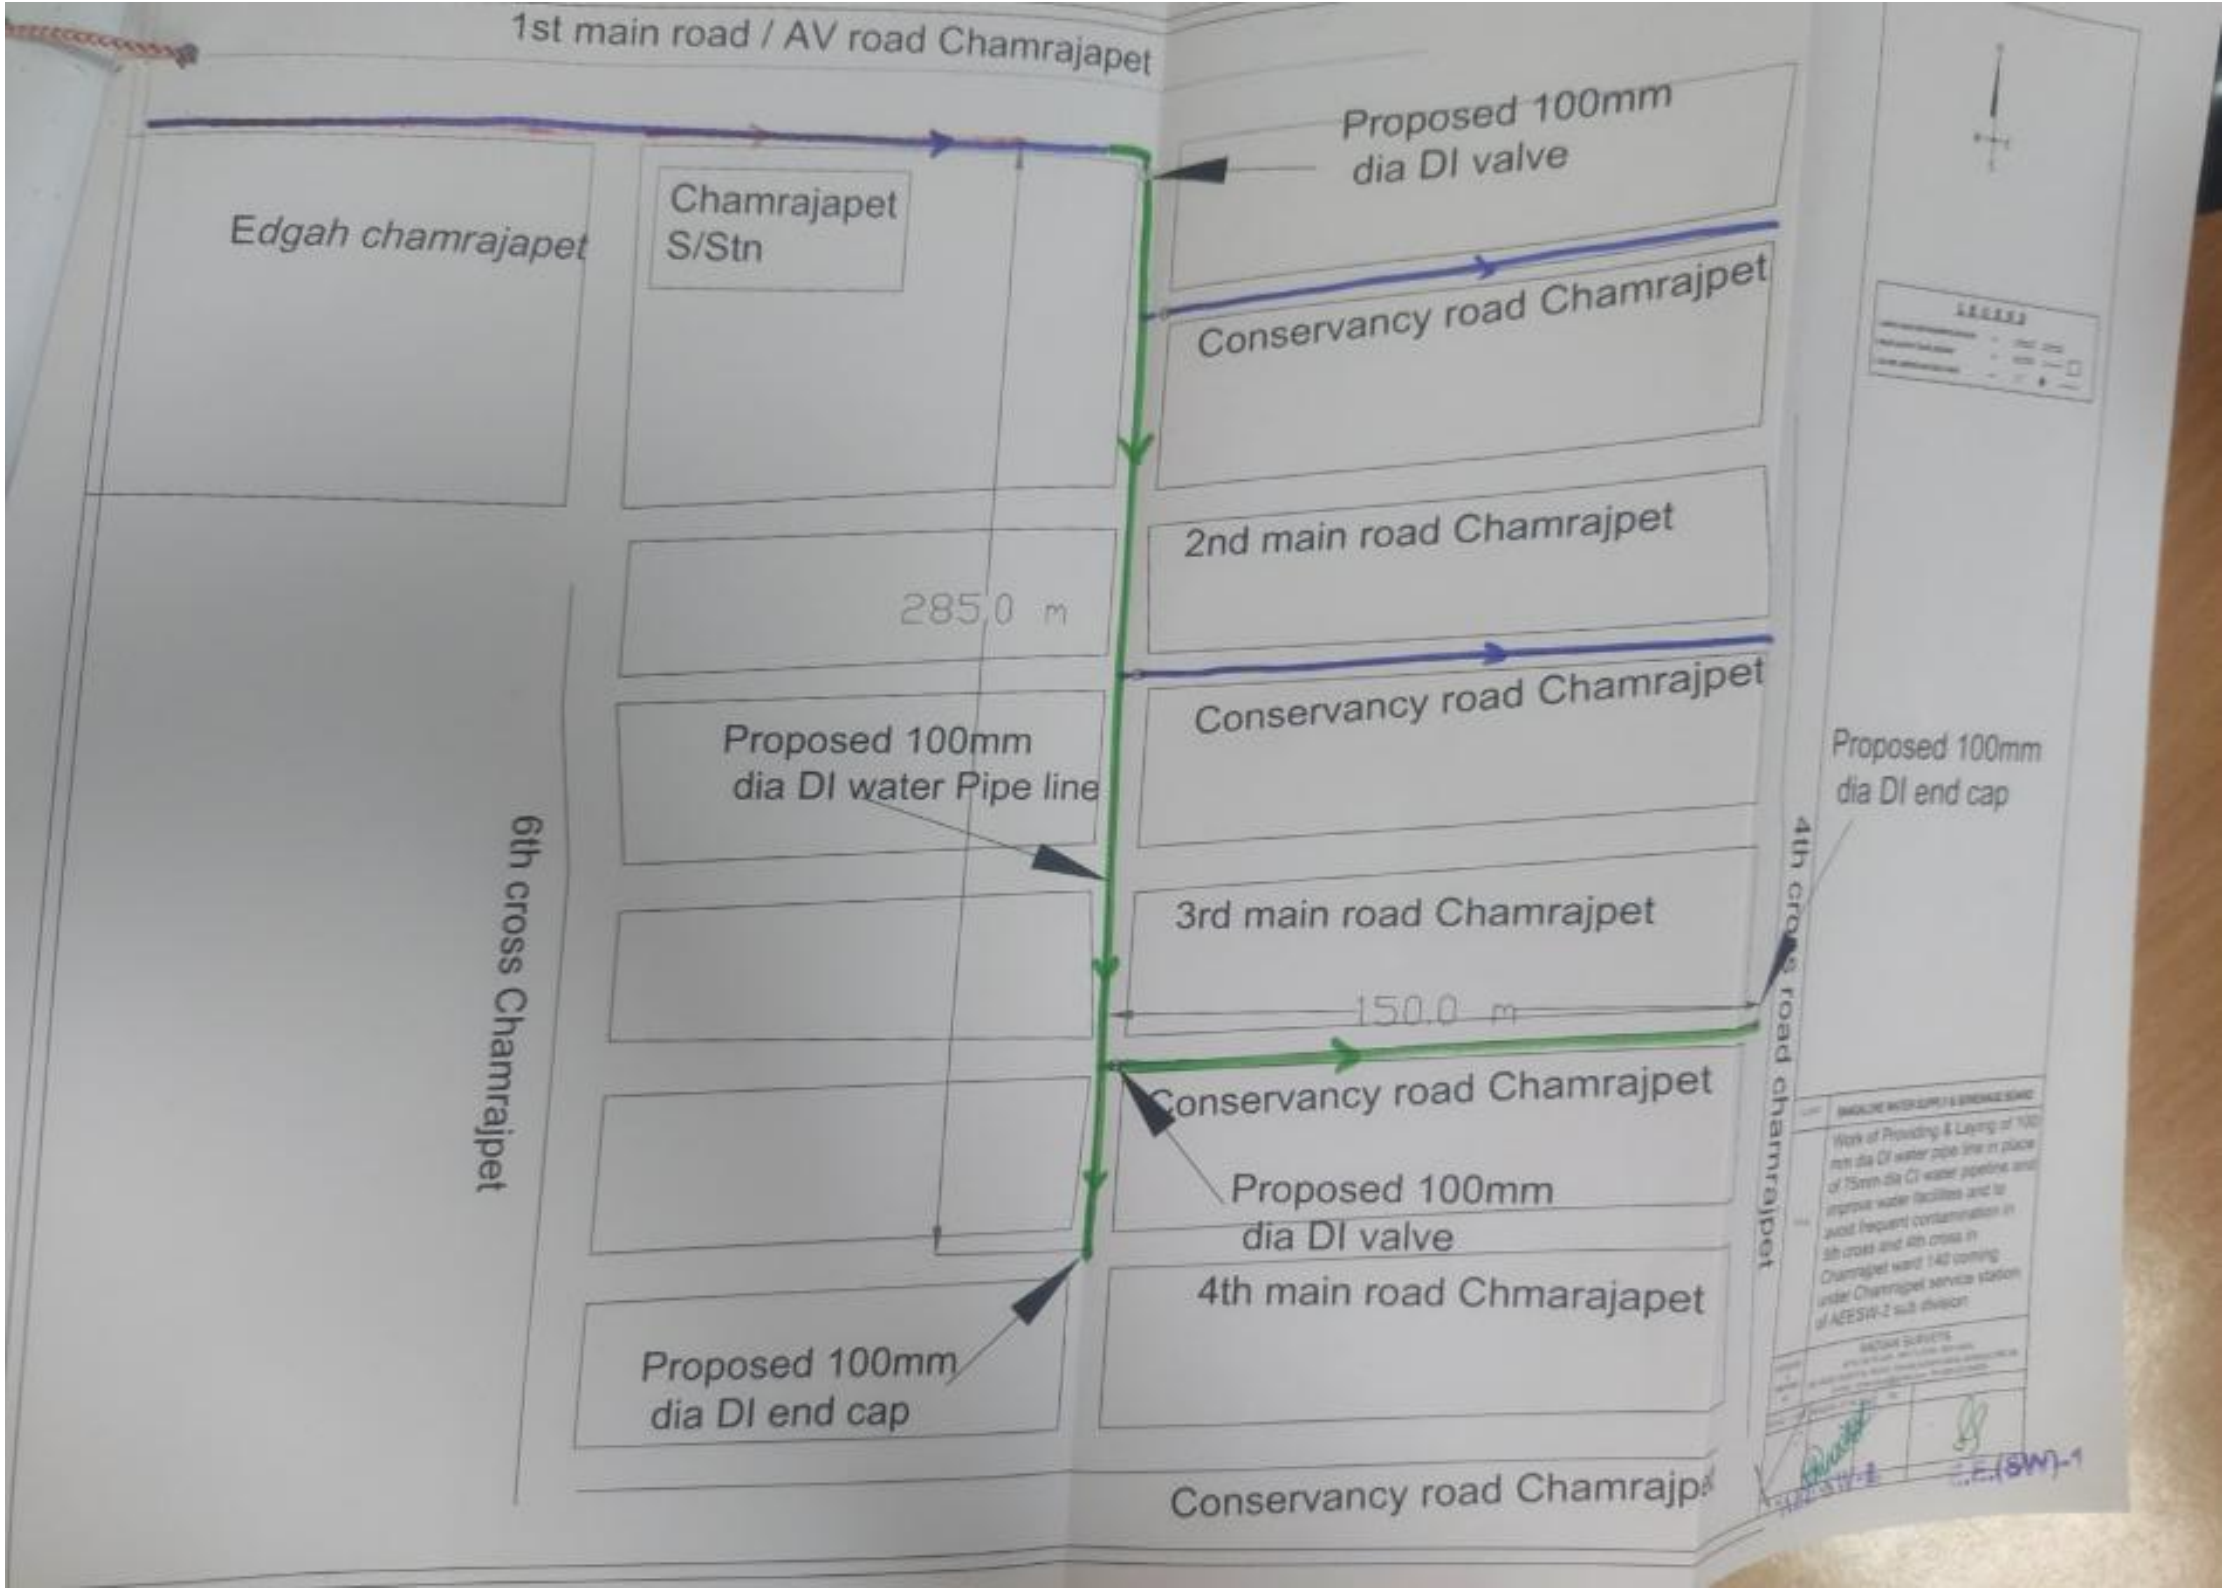
1st main road / AV road Chamrajapet
Edgah chamrajapet
Chamrajapet S/Stn
Proposed 100mm dia DI valve
Conservancy road Chamrajpet
2nd main road Chamrajpet
285.0 m
Conservancy road Chamrajpet
Proposed 100mm dia DI water Pipe line
6th cross Chamrajpet
3rd main road Chamrajpet
150.0 m
Conservancy road Chamrajpet
Proposed 100mm dia DI valve
4th main road Chmarajapet
Proposed 100mm dia DI end cap
Conservancy road Chamrajp
4th cross road chamrajpet
Proposed 100mm dia DI end cap